

TECHNICAL SHEET



Isothermal dehumidifier designed for the control of indoor relative humidity in underfloor/ceiling/wall radiant cooling systems. It consists of a complete refrigerant unit with pre and post treatment hydronic batteries that can use the chilled water supplied to radiant systems.

Galvanised sheet metal frame and stainless steel condensate tray, siphon on condensate drain mandatory. The unit is available in 2 versions, depending from the accessories used:

- version for embedded installation in the wall (composed by recessed box, dehumidification unit and front panel);
- version for external installation on the wall (composed by dehumidification unit and cabinet)

Description	Dimensions (wxhxd)	Weight	Code
RNW 200 P	721x571x200 mm	27,5 kg	70RNWP0200

Components description

- **Compressor:** hermetically sealed with a bipolar single-phase asynchronous motor coupled with an alternative single cylinder compressor
- **Pre-cooling coil:** copper pipe and aluminium fins with hydrophilic treatment
- **Evaporating coil:** copper pipes and aluminium fins with hydrophilic treatment
- **Post-heating coil:** copper pipes and aluminium fins
- **Fan:** double suction centrifugal fan with with 3-speed directly coupled motor
- **Air filter:** with filtering material made of synthetic fibres, class ISO Coarse 40% (G3)
- **Condenser temperature probe:** NTC sensor which measures the temperature of the condenser
- **Water temperature probe:** NTC sensor which measures the temperature of the water
- **Evaporator temperature probe:** NTC sensor which measures the temperature of the evaporator
- **Circuit board fuse:** 250V- 10 A

Package content

- Rnw 200 P
- Installation / Technical Manual

COMPONENTS

AIR FLOWS



Supply Air



Recirculation Air

AIR FILTERS



e(PM10) min ≤50 %
Hairs




Ø 14 mm Condensation Drain



1/2" F Hydraulic connection




Wiring Box

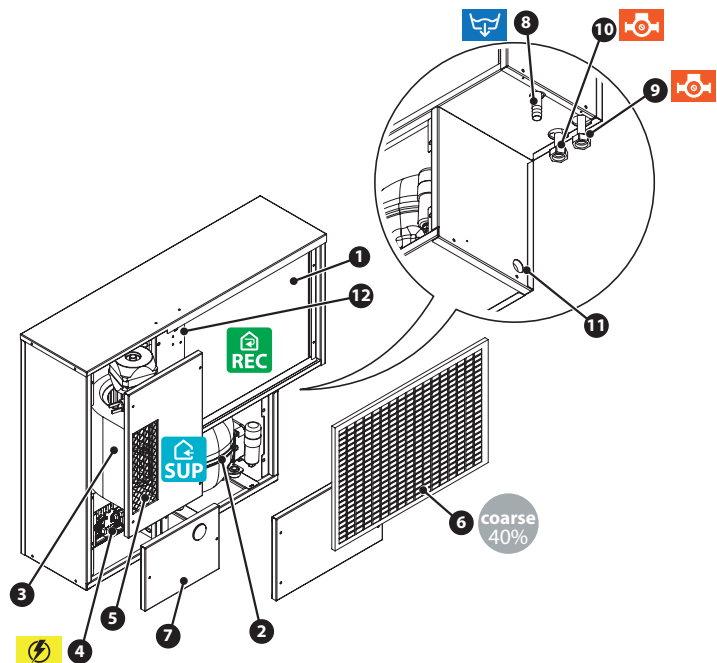


Rif.	Description	Rif.	Description
1	Exchangers	7	Switchboard
2	Compressor	8	Ø 14 mm condensation drain
3	Fan	9	Water inlet (1/2" F)
4	Electronic card	10	Water outlet (1/2" F)
5	Fan grille	11	Access to electric components
6	Filter for air inlet	12	Air vent (behind the filter)

TECHNICAL SHEET

REPLACEMENTS

AIR FILTERS KIT		Code
	RNW 200 P FILTER KIT Kit for complete replacement of unit filters containing: - 1 ISO Coarse 40% filter - Size 460x320x10 mm	7044130

DIMENSIONS AND TECHNICAL DATA

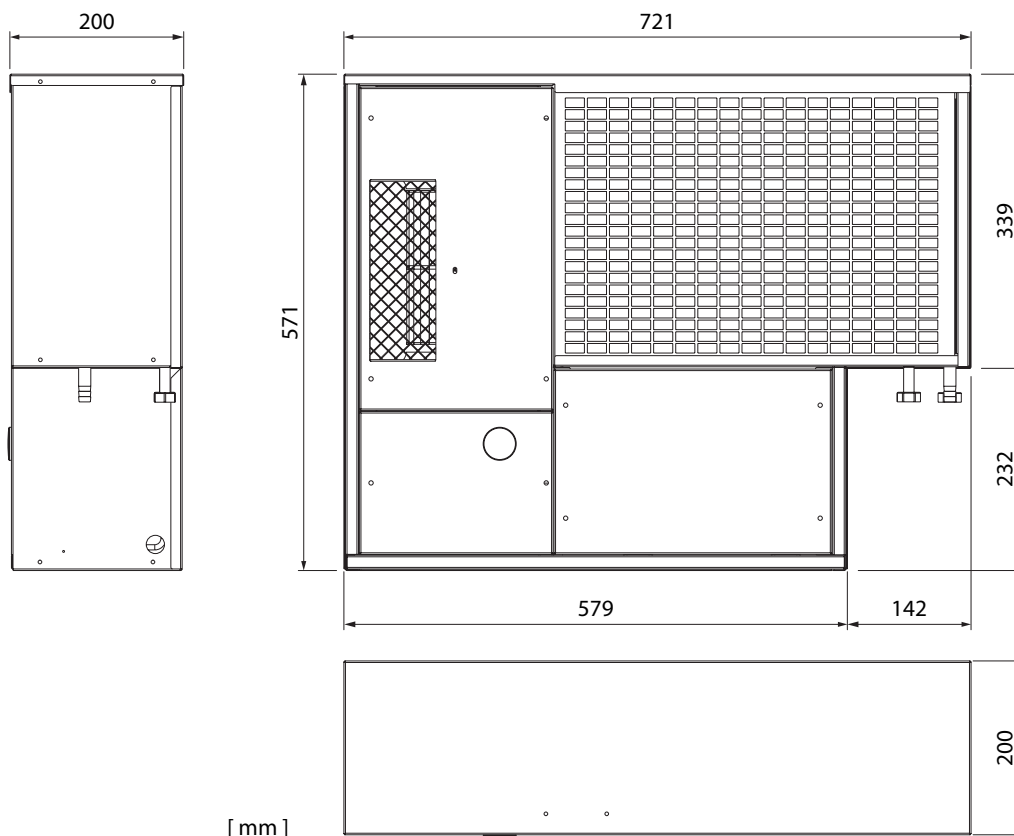

Technical characteristics

Technical specifications

Condensation (26° - 65%)	21	l/day
Rated electrical power	340	W
Total water flow rate	240 (*)	l/h
Pressure loss on the hydraulic circuit	30	KPa
Nominal air flow rate (free outlet)	160	m ³ /h
Refrigerant R290 - GWP: 3	70	g
Carbon dioxide equivalent	0,00021	t

Overall machine dimensions

Height	571	mm
Width	721	mm
Depth	200	mm
Weight	27,5	kg

(*) Flow rate value with +20% and -20% than the mentioned value.

TECHNICAL SHEET

PERFORMANCE


The performance of the machine is directly related to the conditions of the incoming air and its flow rate, as well as the temperature and relative flow rate of the water.

Air		Water	Summary							
160 m ³ /h		240 l/h	Dehumidification							
Pre-Treatment		[REC] Inlet Temp.	Dehumidification				Power		Total Power	
[REC] Inlet Temp.	[REC] Inlet R.H.		[SUP] Output Temp.	[SUP] Output R.H.	Condensation		Latente	Sensible	Room	Fridge group
(°C)	(%)	(°C)	(°C)	(%)	(l/h)	(l/g)	(W)	(W)	(W)	(W)
26	65	18	24,2	50	0,86	21	601	97	698	781
		15	22,3	50	1,04	25	735	200	934	1088
		12	20	46	1,26	30	516	324	840	1395
25	55	18	23,3	42	0,58	14	396	92	487	586
		15	22	46	0,65	16	459	162	621	642
		12	19	46	0,86	21	542	324	865	949
27	60	18	24,6	50	0,83	20	578	130	707	698
		15	22	50	1,04	25	721	270	991	949
		12	19,7	49	1,22	29	864	394	1258	1228

Air		Water	Summary							
160 m ³ /h		200 l/h	Dehumidification							
Pre-Treatment		[REC] Inlet Temp.	Dehumidification				Power		Total Power	
[REC] Inlet Temp.	[REC] Inlet R.H.		[SUP] Output Temp.	[SUP] Output R.H.	Condensation		Latente	Sensible	Room	Fridge group
(°C)	(%)	(°C)	(°C)	(%)	(l/h)	(l/g)	(W)	(W)	(W)	(W)
26	65	18	27	43	0,83	20	589	-54	535	698
		15	25,5	42	1,01	24	700	27	727	977
		12	23	43	1,22	29	855	162	1017	1256
25	55	18	25	39	0,58	14	400	0	400	628
		15	24	42	0,65	16	464	54	518	791
		12	21	43	0,83	20	574	216	790	1023
27	60	18	27	44	0,76	18	532	0	532	721
		15	25	43	0,97	23	681	108	789	1047
		12	22,9	42	1,15	28	817	221	1038	1279






TECHNICAL SHEET

PRESSURE LOSS ON THE HYDRAULIC CIRCUIT

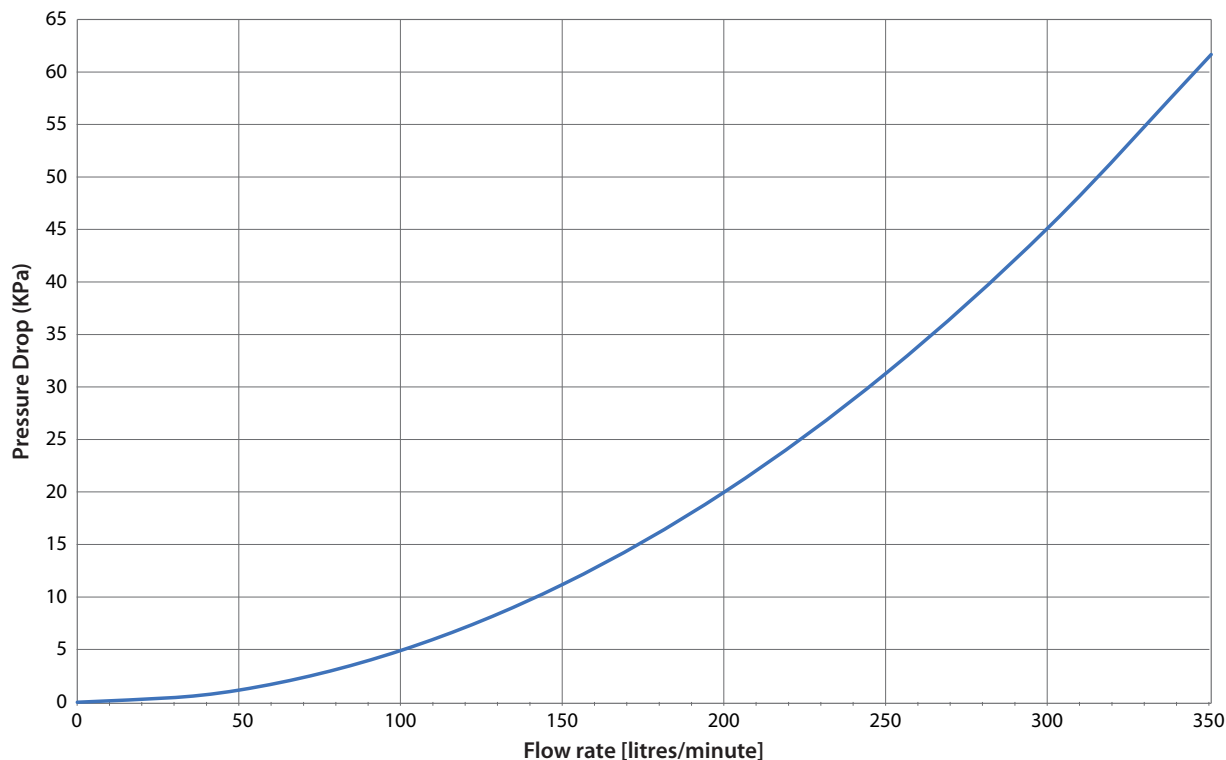

POSITIONING INDICATIONS

- Installation should only be carried out inside buildings
- The dehumidifier must be installed in a place where air can circulate freely, avoiding being positioned at a dead angle, causing a short circuit in the air flow and failing to achieve the required dehumidification effect
- The dehumidifier must be installed in a vertical position on a solid, flat wall
- It is necessary to leave a free space of at least 3 m, from the front of the grille, for the free circulation of the dehumidified air
- The unit should not be placed in rooms with high humidity, such as swimming pools, saunas, etc
- Avoid positioning the unit with constant and direct exposure to sunlight or near heating
- Avoid placing the unit in places where curtains could be placed in front of the dehumidifier, or at heights that could disturb the end user during operation

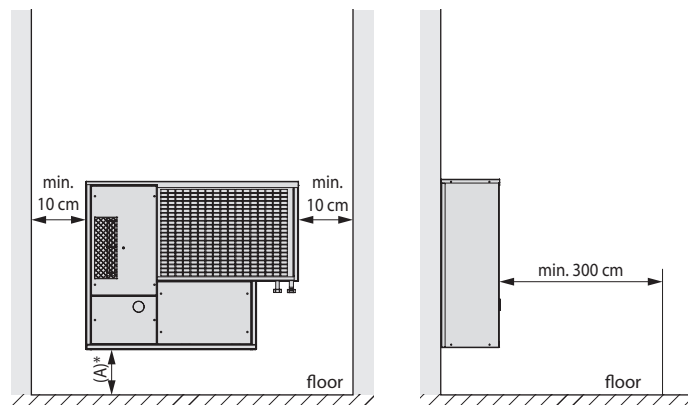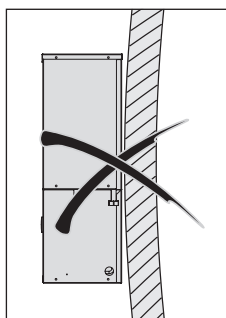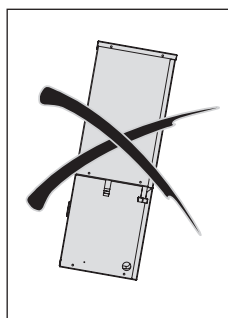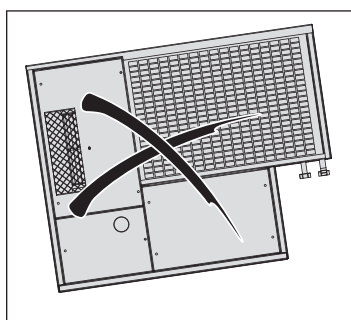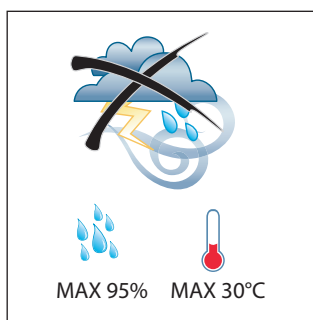

- (A)* It is possible to install the unit flush with the floor, however, to facilitate cleaning operations, we recommend installation in a raised position, maintaining a height of at least 25 mm above the skirting board.

